


S3 COMMUNICATOR


BUILDING POWERED

Emergency Telephone Guide

Use with Part Numbers **11-930** through **11-939**

MAINTENANCE PROCEDURES

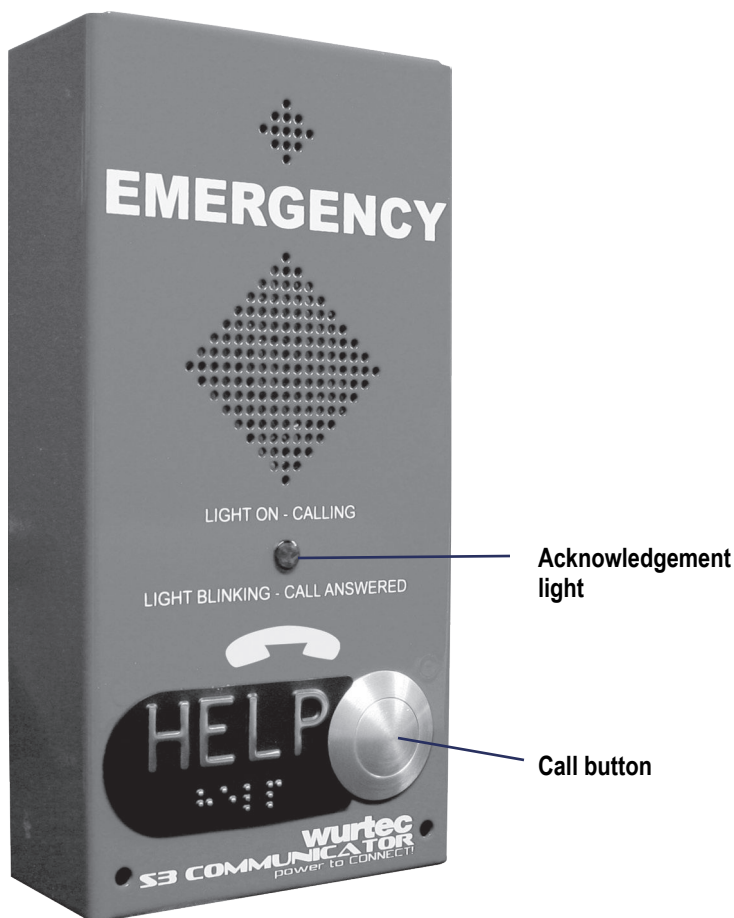

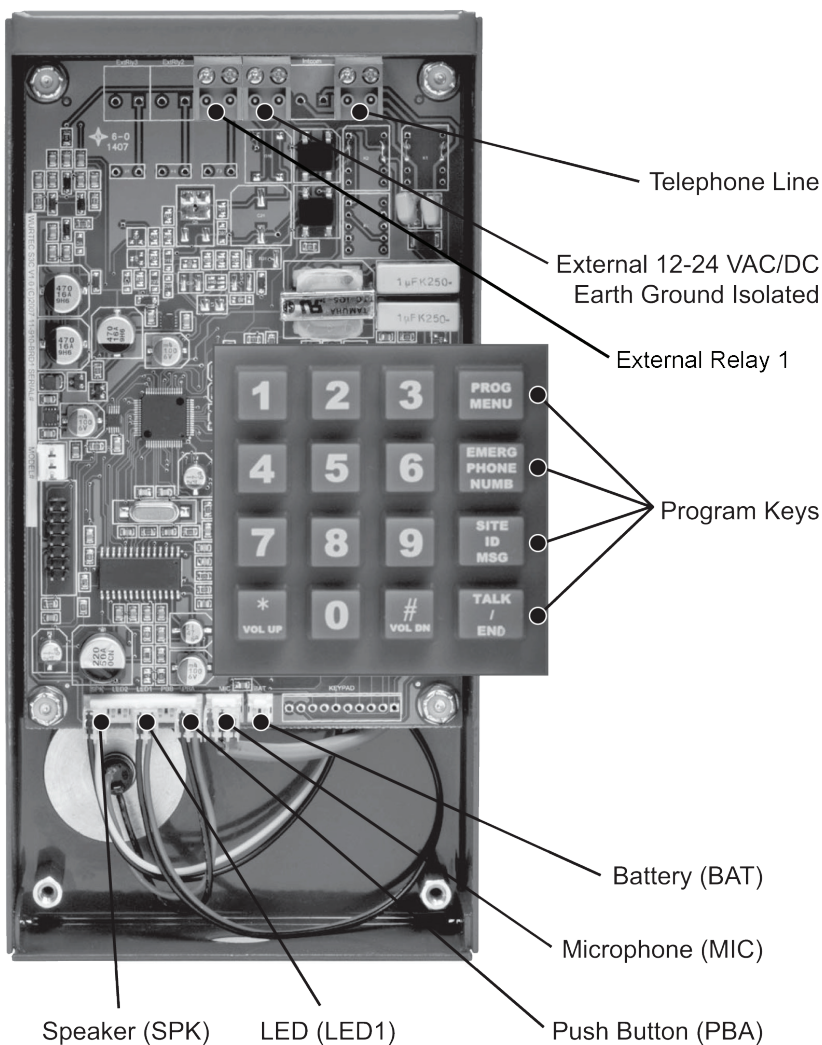

CALL BUTTON

Visually inspect button for damage

Depress call button; confirm activation of

ACKNOWLEDGEMENT LIGHT INSPECTION

Visually inspect light for damage

Depress call button, confirm steady illumination while calling;

blinking illumination after call answered

WIRING CONNECTION

Visually inspect for loose terminals or stray wire strands

Verify that each wire will withstand a minimum of 5# pullout force

BATTERY

Remove battery

Check voltage with a meter

Replace battery if voltage is less than 7.2VDC